



Standard Design Of Rooftop Rainwater Harvesting Structure and Recharge (For Groundwater Abstraction up to 10 m³/d)

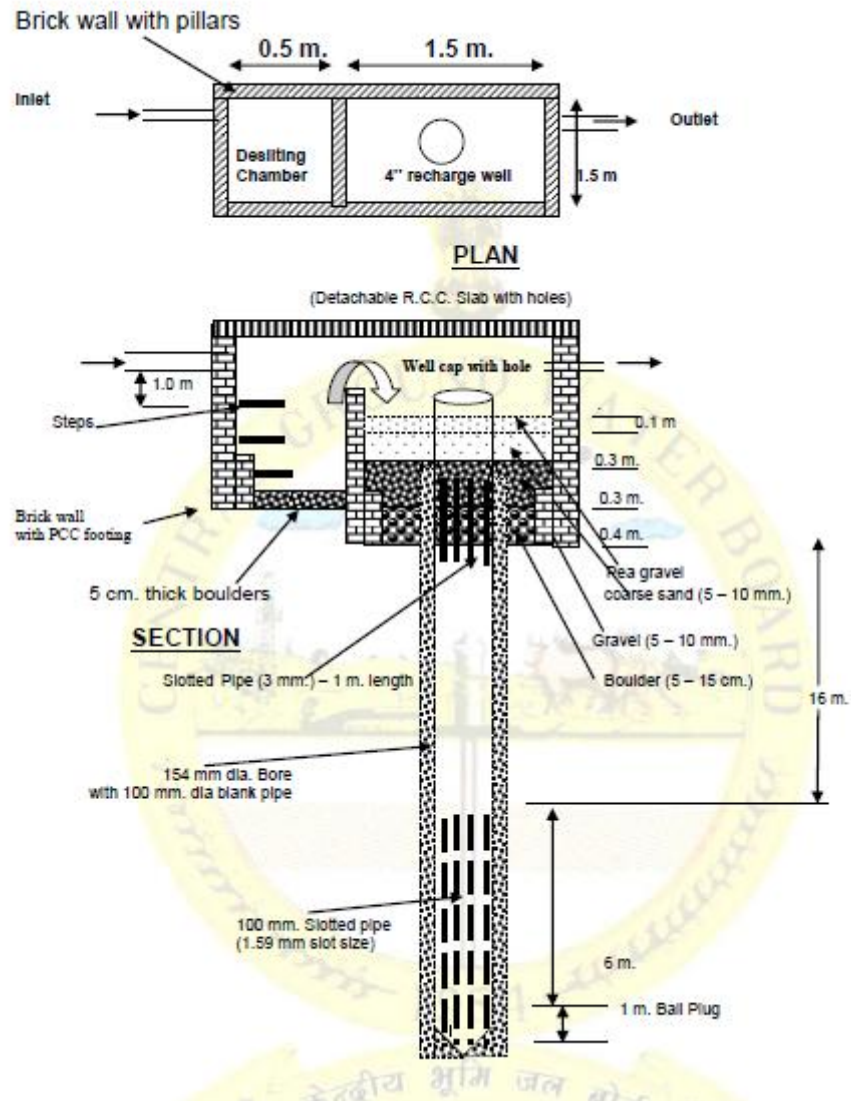


Note:

1. Based on post- monsoon depth to water level, the recharge well depth will change and should be kept 2 to 3 meter above post-monsoon water level.
2. The design is indicative; the actual design may vary as per site condition
3. In case of industries likely to contaminate groundwater such as chemical, pesticide, slaughter house, textile, dyeing, etc. are advised to collect rooftop rain water and store the same for reuse.

Standard Design Of Rooftop Rainwater Harvesting Structure and Recharge (For Groundwater Abstraction up to $10 \text{ m}^3/\text{d}$)

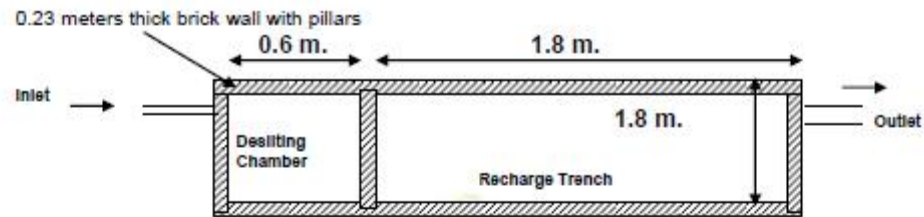

PLAN

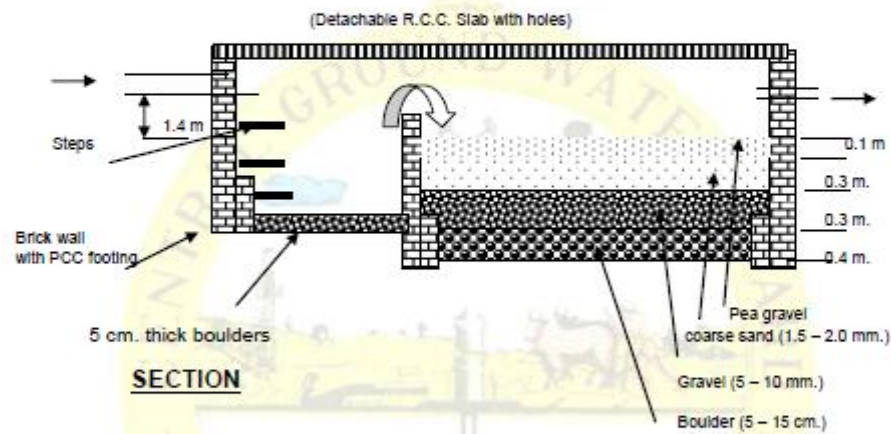

SECTION

(All the dimensions are inner)

Note:

1. The design is indicative; the actual design depends on site condition